



PLANVIEW
OVERLAY
HERE

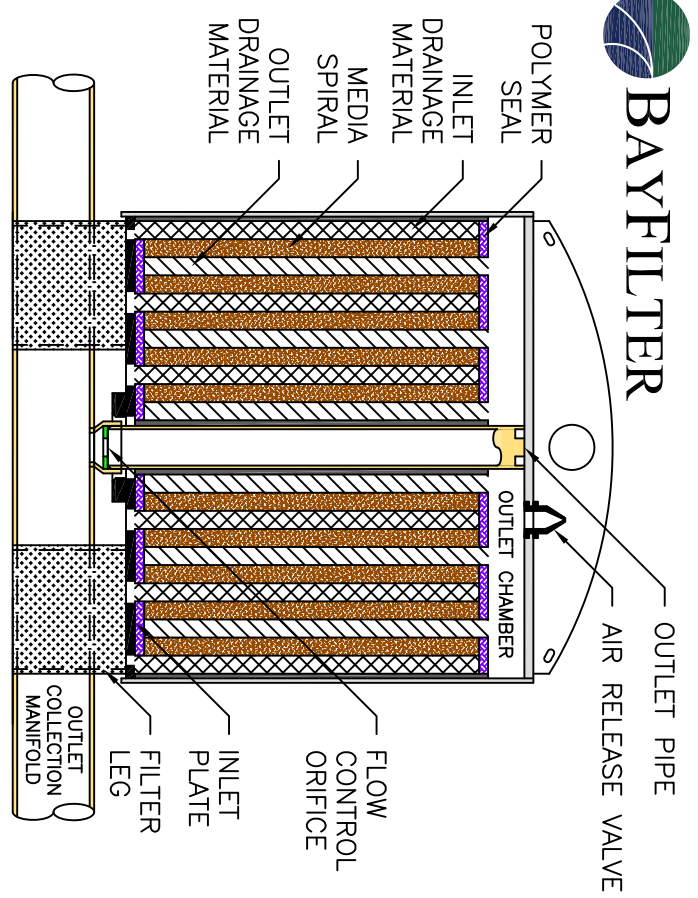

| | |
|----------------------------|----------|
| BAYFILTER 545 | |
| 8-12-11 VAULT | |
| PROJECT | |
| LOCATION | |
| WATER QUALITY FLOW | 1.10 CFS |
| DRAINAGE AREA | |
| CARTRIDGE DESIGN FLOW RATE | 45 GPM |
| # BAYFILTER CARTRIDGES | 11 |
| TREATED SEDIMENT CAPACITY | 3850 LBS |

THE BAYFILTER STORMWATER MANAGEMENT SYSTEM IS A STORMWATER FILTRATION DEVICE DESIGNED TO REMOVE FINE SEDIMENTS, HEAVY METALS, AND PHOSPHORUS. THE BAYFILTER SYSTEM RELIES ON A SPIRAL WOUND MEDIA FILTER CARTRIDGE WITH APPROXIMATELY 90 SQUARE FEET OF FILTRATION AREA. THE FILTER CARTRIDGES ARE HOUSED IN A CONCRETE STRUCTURE THAT EVENLY DISTRIBUTES THE FLOW BETWEEN CARTRIDGES. THE SYSTEM IS OFFLINE WITH AN EXTERNAL BYPASS THAT ROUTES HIGH INTENSITY STORMS AROUND THE SYSTEM. THE FILTER CARTRIDGES REMOVE POLLUTANTS FROM RUNOFF BY FILTRATION (INTERCEPTION/ATTACHMENT) AND ADSORPTION.

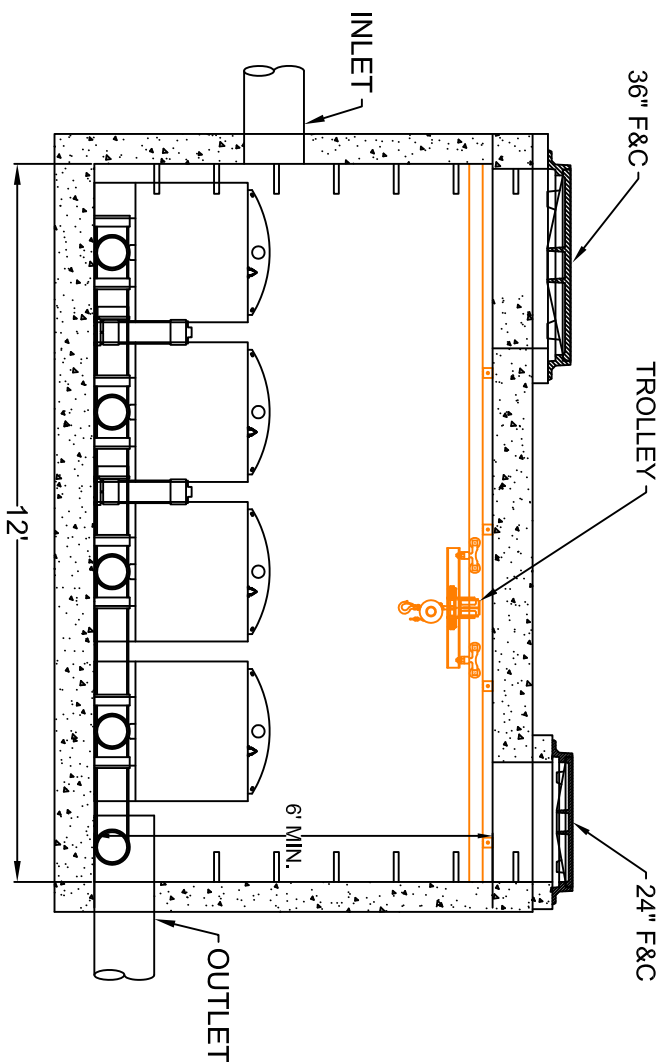

SHOWN WITH MINIMUM RECOMMENDED INSIDE VAULT HEIGHT. IF A SHALLOWER INSTALLATION IS REQUIRED, CONTACT YOUR LOCAL SALES REPRESENTATIVE.



4640 TRUAMAN BLVD
HILLIARD, OH 43026
1-800-733-7473



1030 Deer Hollow Drive 1-800-BAYSAVER
Mount Airy, MD 21771 1-800-229-7283

| REV | DRW | CHK | DESCRIPTION |
|-----|-----|-----|-------------|
| | | | |
| | | | |
| | | | |
| | | | |

| | |
|----------------|--------------|
| DATE: --- | DRAWN: --- |
| PROJECT #: --- | CHECKED: --- |

THIS DRAWING HAS BEEN PREPARED BASED ON INFORMATION PROVIDED TO ADS UNDER THE DIRECTION OF THE SITE DESIGN ENGINEER OR OTHER PROJECT REPRESENTATIVE. THE SITE DESIGN ENGINEER SHALL REVIEW THIS DRAWING PRIOR TO CONSTRUCTION. IT IS THE ULTIMATE RESPONSIBILITY OF THE SITE DESIGN ENGINEER TO ENSURE THAT THE PRODUCT(S) DEPICTED AND ALL ASSOCIATED DETAILS MEET ALL APPLICABLE LAWS, REGULATIONS, AND PROJECT REQUIREMENTS.